



1455 Kleppe Lane ♦ Sparks, NV 89431-6467 ♦ (888) 909-4297

♦ website: www.BritaHydrationStation.com

No. 2077010 (2)

Model 2000S Brita® Hydration Station® with Lifecycle Control

LIMITED WARRANTY

HAWS warrants that this specific product is guaranteed against defective material or poor workmanship for a period of **three years from date of shipment**. HAWS liability under this warranty shall be discharged by furnishing without charge F.O.B. HAWS Factory any goods, or part thereof, which shall appear to the Company upon inspection to be of defective material or not of first class workmanship, provided that claim is made in writing to Haws within a reasonable period after receipt of the product. Where claims for defects are made, the defective part or parts shall be delivered to the Company, prepaid, for inspection. HAWS will not be liable for the cost of repairs, alterations or replacements, or for any expense connected therewith made by the owner or his agents, except upon written authority from HAWS, Sparks, Nevada. HAWS will not be liable for any damages caused by defective materials or poor workmanship, except for replacements, as provided above. Buyer agrees that Haws has made no other warranties either expressed or implied in addition to those above stated, except that of title with respect to any of the products or equipment sold hereunder and that HAWS shall not be liable for general, special, or consequential damages claimed to arise under the contract of sale. The Brita® Hydration Station™ manufactured by HAWS is warranted to function if installation and maintenance instructions provided are adhered to. The units also must be used for the purpose for which they were intended.

NO OTHER WARRANTIES EXPRESSED OR IMPLIED ARE AUTHORIZED, PROVIDED OR GIVEN BY HAWS.

SHOULD YOU EXPERIENCE DIFFICULTY WITH THE USE OF THIS MODEL, OR REQUIRE REPLACEMENT PARTS, PLEASE CALL:

**TECHNICAL SUPPORT:
1-800-766-5612**

HOURS OF OPERATION: MON-THURS 7:00a.m. - 4:00p.m. PT. FRI 7:00a.m. - 1:00p.m. PT

QUICK START REFERENCE (SEE INSTALLATION INSTRUCTIONS FOR FURTHER DETAILS)

RATED SERVICE FLOW: 0.5 GPM (2725L/day) **OPERATING PRESSURE:** 30-90 PSI

OPERATING TEMPERATURE: 35-100°F (1.7-37.8°C)

FILTER CAPACITY: 2500 gallons (9464L) or 1 year

REPLACEMENT FILTER CARTRIDGE: Brita® Electronic Lifecycle Control Filter Model 6429

WATER SUPPLY REQUIREMENTS: 30-90 PSI (2-6 ATM) supply; cold water only.

Do not use with water that is microbiologically unsafe or of unknown quality without adequate disinfection before or after the system. Systems certified for cyst reduction may be used on disinfected waters that may contain filterable cysts.

WASTE REQUIREMENTS: An acceptable trap must be used after the waste bend.

NOTE: When installing this unit, all pertinent local, state, or federal codes should be adhered to.

BRITA Trademark Usage Guidelines

The Brita trademark and Brita logo (collectively, the “Brita Marks”) are among the most critical elements of Brita, LP’s identity and convey many aspects of our business. The Brita Marks are widely recognized, positive industry symbols and can be a very effective way to highlight your commitment to the environment and providing high quality drinking water to your patrons.

The following guidelines apply to customers of the Brita® Hydration Station® water dispensing units and Brita® filters.

Your purchase of this Brita® product authorizes your company to use and/or display the Brita Marks as long as:

- You continue to use Brita® filters in the Brita® Hydration Station® water dispensing unit and replace the Brita® filters as instructed
- You maintain your Brita® product at an appropriate level to provide high quality drinking water to your patrons
- You do not disparage Brita, LP or Brita® products
- You do not imply a relationship or association with Brita, LP that does not exist
- You adhere to these Trademark Usage Guidelines


Improper use of the Brita Marks may be considered a violation of these Trademark Usage Guidelines, and Brita, LP reserves all rights to enforce proper use of its trademarks, including but not limited to having you remove or cover up the Brita Mark on the product.

In the event you have questions about the proper use of the Brita Marks, the Brita® filters or the Brita® Hydration Station® water dispensing unit, please call 888-909-4297 to be connected to a representative of Haws Corporation. The Brita Marks are registered trademarks of Brita, LP and are used under license by Haws Corporation.

Haws Corporation
1455 Kleppe Lane • Sparks, NV 89431
1-888-909-4297
www.Britahydrationstation.com


Trademark Use Guidelines (TUG)

- **Before first use**, the installer will need to remove the bright orange TUG label over filter head (see right), thereby accepting the guidelines.
 - The TUG label reads as follows: ***Removal of this label signifies you or an appropriate owner’s agent will comply with all BRITA® Trademark Usage Guidelines as well as maintain the unit to the standards as first installed. Detailed information noting requirements can be found within the unit as well as in the Owner’s Manual on Page 2.***
- The complete Trademark Usage Guidelines are located in 2 places for reference by owner/maintenance personnel.
 - Within the Brita® Hydration Station® unit.
 - Above





Maintenance Label

- When installation of the Brita® Hydration Station® is complete, **obtain a phone number for the sales representative that sold you the unit.** Write this number into the maintenance label located in the lower right-hand corner of the front of the unit (see below) and use for maintenance and troubleshooting questions.
- If any issues or questions arise that cannot be addressed by this Owner's Manual, refer to this label, which also contains the Haws® (888) 909-4297 customer service phone number and a serial number for tracking.

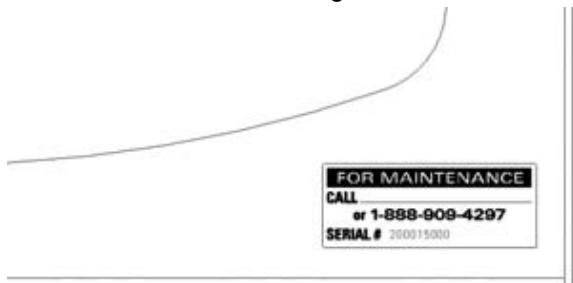


General Operation


- Approach the Brita® Hydration Station® with a bottle (or other multi-use water container). Note the start/stop activation label (seen to right) at the center of the unit – in & up to activate; down & out to deactivate.
- Place the bottle in the opening and move upward to the sensor (see below).
- When the sensor detects the bottle, a blue light will activate to help position the bottle under the nozzle. After a slight delay, water will dispense.
- When the bottle is filled, lower it from the sensor to stop the water flow.
 - There is a 30 second shut-off feature to prevent needless dispensing.

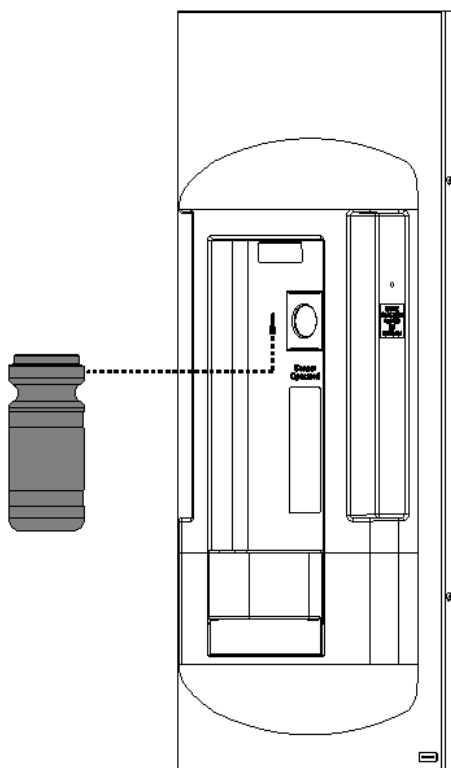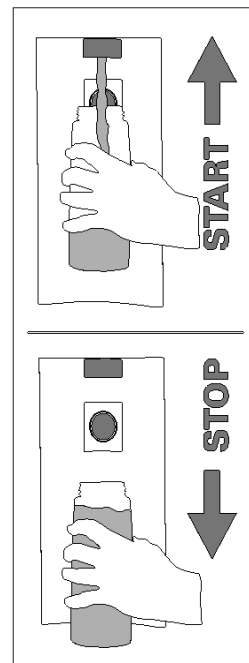

Activate

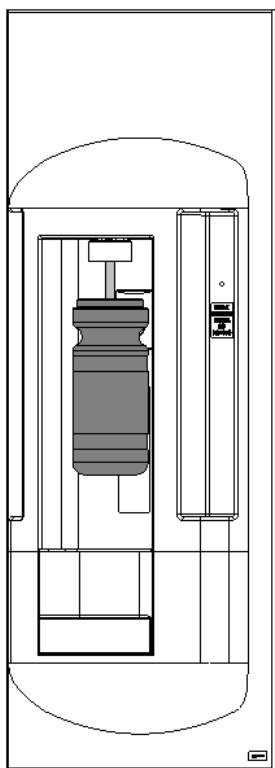


Fill

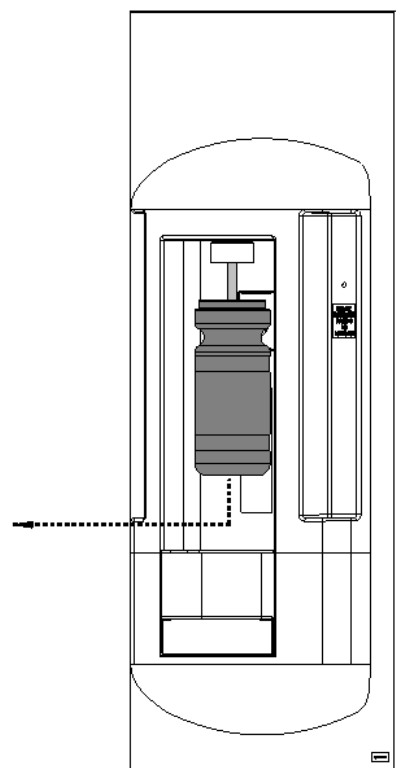

Deactivate


General Operation (continued)

- As water dispenses, the LED light to the far right of the sensor (see right) will flash **green** several times, indicating that the filter is working properly. This same LED will change to a blinking **yellow** when filter life reaches 10% remaining (filter change recommended).
- When the filter has reached end of life, the indicator LED will flash **red** and the unit **will not dispense** water until the filter is replaced.

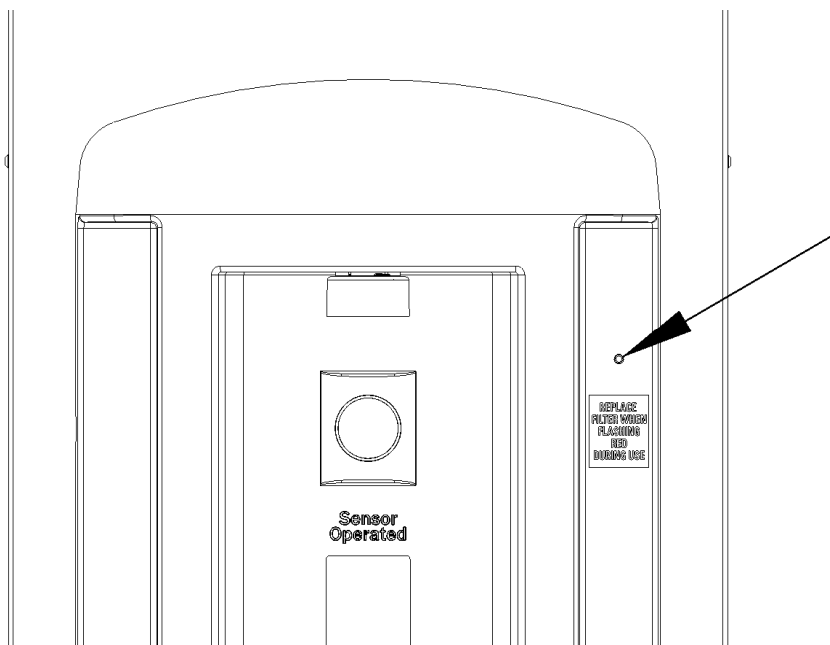

Auto Purge & Periods of Inactivity

- The Brita® Hydration Station® is designed to purge itself after every 24 hours of non-use. This effectively removes the standing water from the system and introduces new water in an effort to prevent the growth of bacteria.
- If there is an atypically lengthy period of time during which the Brita® Hydration Station® is not in use, it is advisable that the filter cartridge be replaced when the system comes back on line.

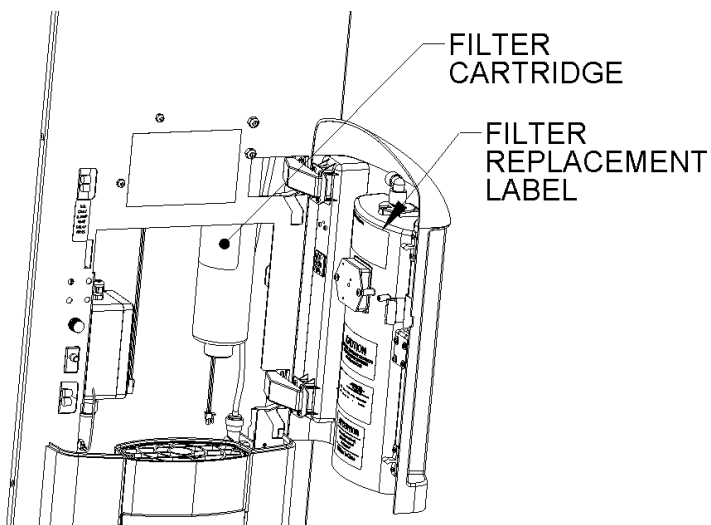

Water Quality

- The Brita® Hydration Station® is not intended to purify water. Do not use this system with water that is microbiologically unsafe or of unknown quality without adequate disinfection before or after the system. Individuals requiring water of special microbiological purity should follow the advice of their doctor or local health officials regarding the use and consumption of their tap water.

Maintenance


WARNING:

1. Make certain power is disconnected before servicing to reduce the risk of electrical shock.
2. Do not touch any circuit board for any reason.

CAUTION: Do not use an abrasive cloth, brush, polishing compound, or abrasive cleaner to clean any part of the unit.


Filter Replacement

- For filter replacements, please contact Haws customer service at 1-888-909-4297, or visit www.BritaHydrationStation.com. It is recommended that at least one filter replacement is on hand for immediate replacement purposes.
- Maintenance personnel can determine filter life as outlined on page 4. The filter should be changed if the filter LED begins to blink yellow or red, if 1 year has elapsed since the filter was installed, or if the water output begins to decrease.
- **To open the unit**, slide the supplied hex key (or a long, small slotted screwdriver) into the notch in the left-hand side of the hinged upper panel and press the key firmly in that same direction. This will disengage the internal spring latch. Simultaneously pull open the hinged panel. Take care not to damage the stainless steel panel or the spring latch in this process.
 - NOTE: Opening the hinged panel cuts the power to the sensor and the solenoid valve, preventing accidental activation.

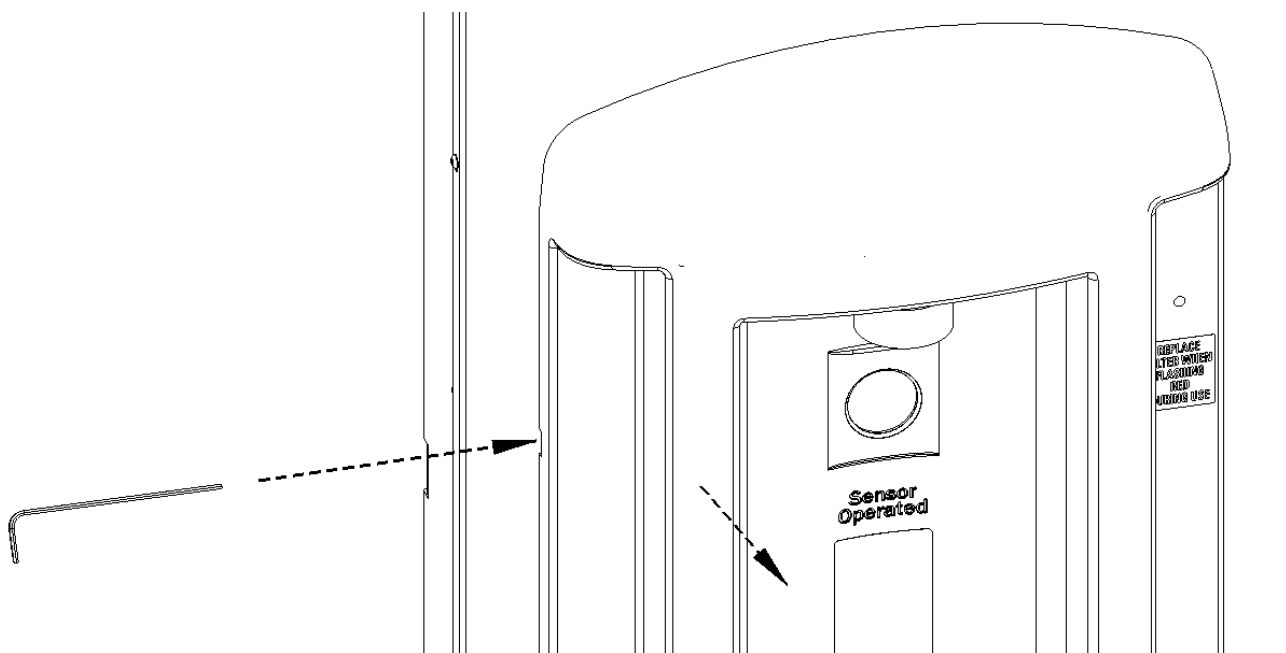

Maintenance (continued)


- An instructional label is visible when the hinged panel is opened, noting how to replace the filter (see below).
 - NOTE: Water does not need to be shut off to replace the filter cartridge; however, it should be shut off if the filter head is going to be left without a cartridge installed for a long period of time.

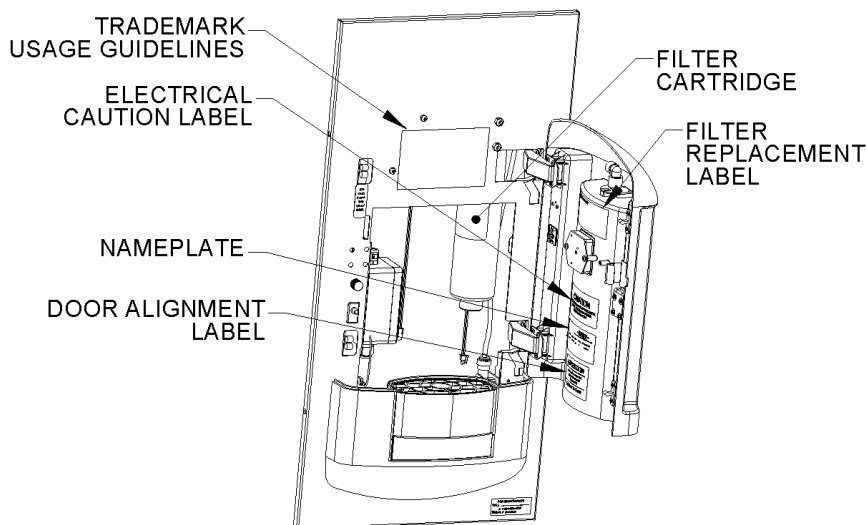

1. Disconnect the old filter cartridge's wiring and unscrew the old cartridge.
2. Screw the new cartridge firmly into the filter head and connect the new cartridge's wiring.
3. The filter status LED should flash green both after the hinged plastic panel is first closed and when water is dispensing. If it does not, consult the Troubleshooting Guide.
4. **Approximately five gallons** of water must be run through the system after the cartridge is installed in order to remove the loose carbon particles from the filter cartridge and any air bubbles from the system.
5. Open the unit and examine to assure that there are no leaks; close unit.

Purge Cycle & Cleanliness

- For hygienic purposes, the unit purges itself briefly if it has not been used in 24 hours. However, it is recommended that the drain basin be regularly cleaned and disinfected with Clorox® Regular Bleach – use $\frac{3}{4}$ cup Clorox® bleach and mix in 1 gallon of water. Pour slowly throughout the drain basin and let stand for 5 minutes. Flush with water and let air dry.
 - To access the drain basin for cleaning, open the hinged upper panel and remove the drain grate (see right).
- The rest of the unit may be cleaned with a mild sanitizing cleaner, such as Clorox® Anywhere® Hard Surface™ Daily Sanitizing Spray.

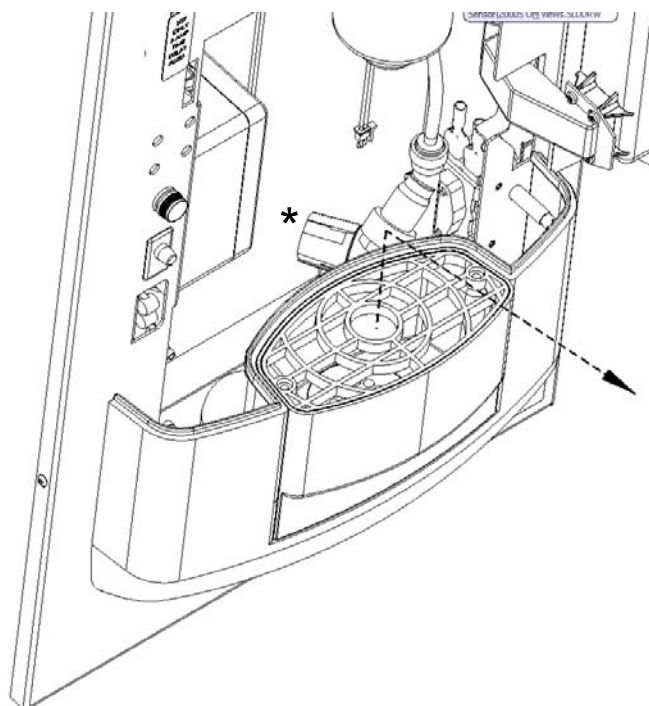

The Clorox® trademark and logo are registered trademarks of the Clorox Company. All rights reserved.

BRITA® HYDRATION STATION® TROUBLESHOOTING

PROBLEM	REPAIR CHECKLIST
1. Low water flow.	<ul style="list-style-type: none"> a. Change filter cartridge. b. Verify minimum 30 psi supply pressure. c. Check that the inlet screwdriver stop valve (not supplied) is in the wide-open position. d. Check that pressure regulator is open (in picture at bottom of page 6; marked with asterisk – pull knob out and rotate counterclockwise from front of unit). e. Contact Haws Technical Support @ 1-800-766-5612.
2. Unit activates by itself.	<ul style="list-style-type: none"> a. Unit self-purges every 24 hours if not used. b. Check the filling area for (and remove) any debris, etc. c. Contact Haws Technical Support @ 1-800-766-5612.
3. Water will not flow; blue nozzle LEDs activate.	<ul style="list-style-type: none"> a. If the filter indicator LED is blinking red, either the filter has expired and must be replaced, or its wiring is not connected. b. If a new filter was just installed, cycle power off and on (e.g. open/close hinged panel). c. If the nozzle LEDs have activated by themselves, the sensor is detecting something and has timed out. Check the filling area for (and remove) any debris, etc. d. Verify inlet water pressure; check that any inlet screwdriver stop valve is wide open. e. Trigger the sensor and listen for a click or a hum to indicate that the solenoid is functioning. If nothing is heard, the solenoid may be malfunctioning. f. Contact Haws Technical Support @ 1-800-766-5612.
4. Water will not flow; blue nozzle LEDs do not activate.	<ul style="list-style-type: none"> a. Keep your hand closer to the top of the bottle, etc. while attempting to fill it. b. Make sure the unit has power (look up at the nozzle – the LEDs should be flashing). c. Check to see if fuse has blown (fuse holder is located on stainless panel behind hinged plastic panel). Replace only with Bussmann MDL-1/4" 0.25A time-delay fuses. d. Check the circuit breaker for this unit. e. Contact Haws Technical Support @ 1-800-766-5612.
5. Water is observed anywhere other than the outlet nozzle.	<ul style="list-style-type: none"> a. Shut off water supply and contact Haws Technical Support @ 1-800-766-5612.
6. Water excessively splatters in drain.	<ul style="list-style-type: none"> a. Turn down the pressure regulator (in picture at bottom of page 6; marked with asterisk – pull the knob out and rotate it clockwise from the front of the unit). b. Check nozzle for debris (if necessary, the nozzle may be unbolted from the inside by removing the 2 Phillips screws).
7. Filter status LED is blinking yellow or red when unit is used.	<ul style="list-style-type: none"> a. Replace filter cartridge; ensure wiring is connected properly. b. If a new filter was just installed, cycle power off and on (e.g. open/close hinged panel).

PERFORMANCE DATA SHEET

IMPORTANT NOTICE: Read this Performance Data Sheet and compare the capabilities of this unit with your actual water treatment needs. It is recommended that, before purchasing a water treatment unit, you have your water supply tested to determine your actual water treatment needs.

Substance	Influent Challenge Concentration	Reduction Requirement	Maximum Permissible Product Water Concentration	Average Percent Reduction
Chlorine, Taste and Odor	2.0 mg/L \pm 10%	\geq 50%	N/A	96.6%
Lead	0.15 mg/L \pm 10%	N/A	0.010 mg/L	99%
Cyst	Minimum 50,000/L	99.95%	N/A	99.99%

This system has been tested according to NSF/ANSI 42/53 for the reduction of the substances listed. The concentration of the indicated substances in water entering the system was reduced to a concentration less than or equal to the permissible limit for water leaving the system, as specified in NSF/ANSI 42/53.

Testing was performed under standard laboratory conditions. The contaminants or other substances removed or reduced by this water treatment device are not necessarily in all users' water. Filter performance may vary based on local water conditions.